

Certificate

www.bsria.co.uk

Certificate No: 53317/1

Issue No: 1

Date of issue: 11 August 2009

This is to certify that

BSRIA Limited

Has tested a sample of the product described below in accordance with the test methods contained within EN 13030 : 2001 and has determined the item met the detailed classification shown on pages 3 and 4 of this certificate. For further details of the test item see Page 2 of this certificate

Manufacturer/Agent Antamex International Inc
210 Great Gulf Drive
Concord
Ontario
L4K 5W1
Canada

Product L600

Test location BSRIA Ltd
Old Bracknell Lane West
Bracknell
Berkshire, RG12 7AH

Date of test 3 to 6 August 2009

Expiry date 11 August 2012

Test engineer M Roper

Quality approved Phil Stonard
Laboratory Manager
Testing & Certification

This certificate must not be reproduced except in full without the written approval of an executive director of BSRIA. It is only intended to be used within the context described in the text.

BSRIA Limited

Old Bracknell Lane West, Bracknell, Berkshire RG12 7AH UK

T: +44 (0)1344 426511 F: +44 (0)1344 487575

1 of 5

E: bsria@bsria.co.uk W: www.bsria.co.uk

Certificate No: 53317/1

Issue No: 1

Date of issue: 11 August 2009

TEST ITEM INFORMATION

Contract	53317
Date	03/08/2009
Manufacturer	Antamex International Inc
Louvre Model	L600
Material	Aluminium
Painted	No
Blade Height	998 mm
Blade Width	968 mm
Blade Depth	146 mm
Frame Depth	148 mm
No.of Blades	12
Blade Pitch	80 mm
Blade Angle	45 Degrees
No.of Banks	2
Guard Type	None
Guard Spacing	N/A
Side Channels	Yes
Water Drip Tray	Yes (43mm)
Blade Orientation	Horizontal




WATER PENETRATION

MANUFACTURER Antamex International Inc
 MODEL L600

Date 03/08/2009
 Contract 53317

Simulated rainfall 75 mm/hr
 Wind speed 13.0 m/s
 louvre height 998 mm
 louvre width 968 mm
 louvre area 0.966 m²

VENTILATION RATE		WATER FLOW RATES		Effectiveness	Class
Volume m ³ /s	Velocity m/s	Supply l/h	Penetrated l/h		
0.00	0.00	90.9	0.5	99.4%	A
0.48	0.50	90.9	0.5	99.3%	A
0.96	1.00	90.3	0.7	99.1%	A
1.46	1.51	93.0	1.0	98.6%	B
1.94	2.01	92.5	2.4	96.7%	B
2.43	2.52	92.5	7.5	89.7%	C
2.90	3.00	91.4	14.5	80.0%	D
3.39	3.51	90.9	21.0	71.0%	D

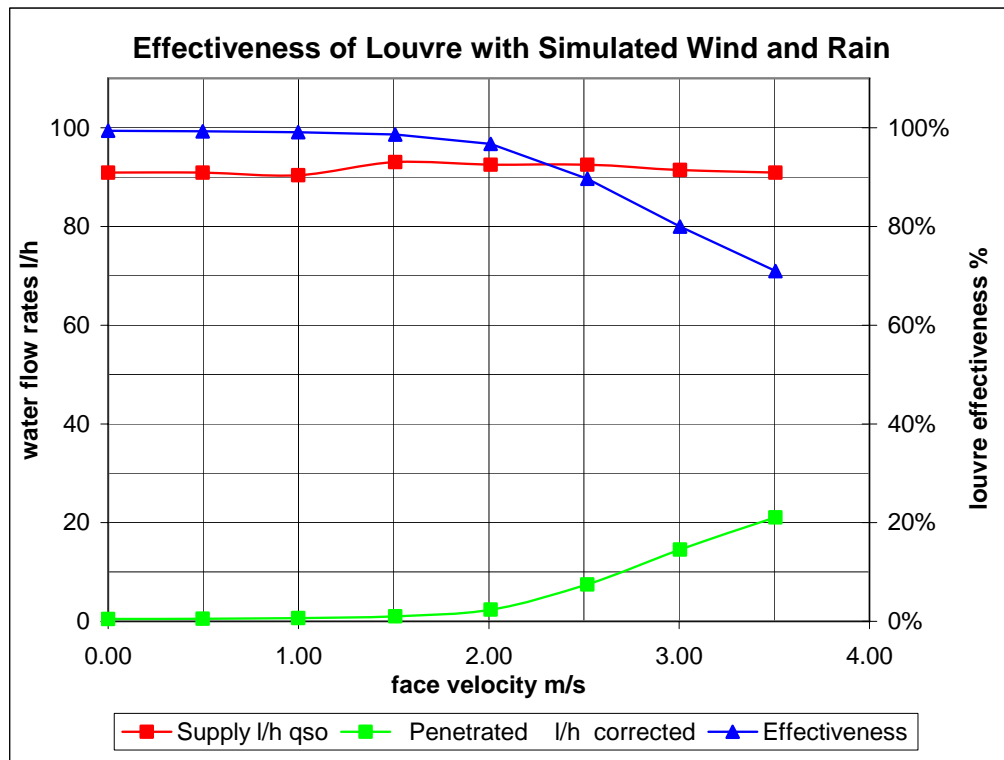


ENTRY LOSS COEFFICIENT

MANUFACTURER Antamex International Inc
 MODEL L600

Date 06/08/2009
 Contract 53317

air temperature 21.1 °C louvre height 998 mm
 barometer 1012 mbar louvre width 968 mm
 air density 1.193 kg/m³ louvre area 0.966 m²

louvre pd Pascals	louvre face velocity	air flow rate		coefficient C _e
	m/s	test m ³ /s	theoretical m ³ /s	
12.3	1.04	1.008	4.387	0.230
23.7	1.45	1.401	6.089	0.230
39.9	1.88	1.813	7.901	0.229
56.7	2.23	2.159	9.419	0.229
76.0	2.59	2.501	10.905	0.229
92.7	2.84	2.745	12.043	0.228
115.8	3.18	3.069	13.460	0.228
151.8	3.64	3.512	15.411	0.228
mean C _e				0.229
Class				3

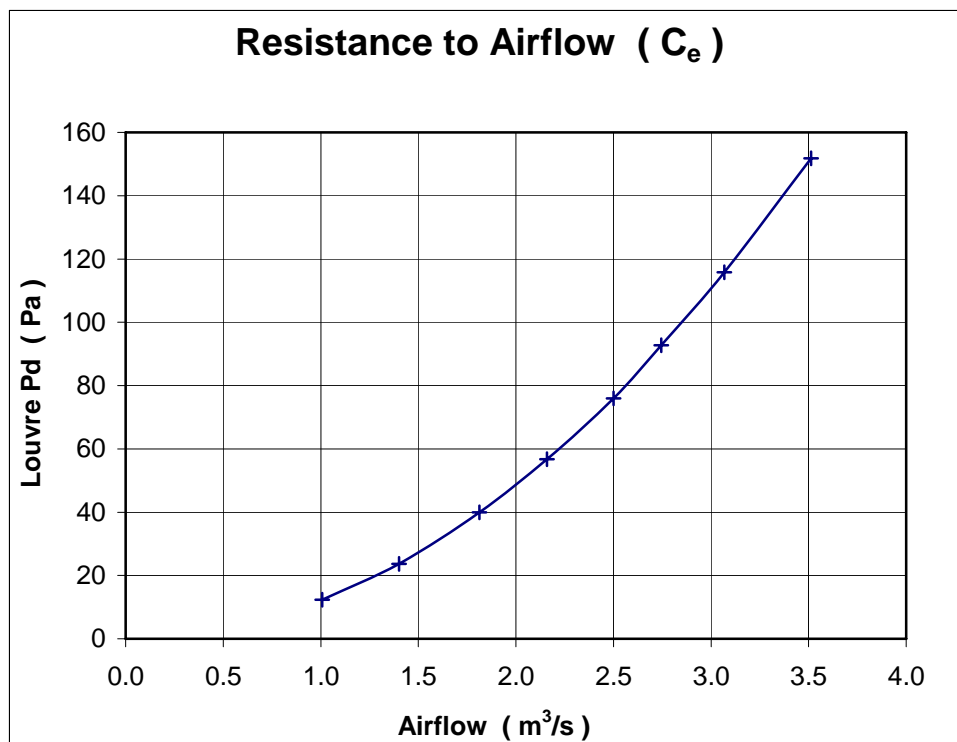

CLASSIFICATION OF WEATHER LOUVRES

Weather louvres shall be classified by their ability to reject simulated rain.

Penetration Classification

Table 1 shows the different classifications based on the maximum simulated rain penetration per square metre of louvre. The classification is determined in accordance with section 8 of EN 13030:2001.

Water penetration rating at a given louvre face velocity is determined by the water penetration while the louvre is subjected to a 13 ms^{-1} simulated wind velocity and a simulated rain fall at the nominal rate.

Table 1 Penetration classification

Class	Effectiveness	Maximum allowed penetration of simulated rain $\text{l.h}^{-1}.\text{m}^{-2}$
A	1 TO 0,99	0,75
B	0,989 TO 0,95	3,75
C	0,949 TO 0,80	15,0
D	Below 0,8	Greater than 15,0

These classifications apply to various core velocities.

Discharge Loss Coefficient

The discharge loss coefficient given in Table 2, shall be determined in accordance with section 7.2 of test standard EN13030:2001.

Table 2 Discharge loss coefficient classification

Class	Discharge Loss Coefficient
1	0,4 and above
2	0,3 to 0,399
3	0,2 to 0,299
4	0,199 and below

(Note: The above also applies to entry loss coefficient)